


✓	AIRFLOW SIZE (INCH)	ACTUAL SIZE		AIRFLOW CAPACITY (CFM)
		H	W	
	20 X 20 X 4	19.38	19.38	1,390
	24 X 12 X 4	23.38	11.38	1,000
	24 X 20 X 4	23.38	19.38	1,670
	24 X 24 X 4	23.38	23.38	2,000
	25 X 16 X 4	24.38	15.38	1,390
	20 X 16 X 4	19.38	15.38	1,110
	24 X 18 X 4	23.38	17.38	1,500
	25 X 20 X 4	24.38	19.38	1,740

GENERAL NOTES:

1. MEDIUM EFFICIENCY, MERV 11-14 PANEL PLEATED DISPOSABLE. FILTER EFFICIENCY NOTED IS MINIMUM MERV RATING WHEN TESTED IN ACCORDANCE WITH ASHRAE 52.2-(LATEST REV.)
2. AVAILABLE SIZES (NOMINAL) AND EFFICIENCIES: SEE TABULATION BLOCK.
3. SEE CAMFIL FARR BULLETIN 1608-(LATEST REV.) AND PRODUCT RTF SPECIFICATIONS FOR OTHER FEATURES, CONSTRUCTION AND PERFORMANCE CHARACTERISTICS.

PERFORMANCE NOTES:

1. SEE TABULATION BLOCK FOR AIRFLOW CAPACITY
2. CAMFIL FARR RECOMMENDS FILTER TO BE INSTALLED WITH THE PLEATS RUNNING PARALLEL TO HEIGHT DIMENSION.

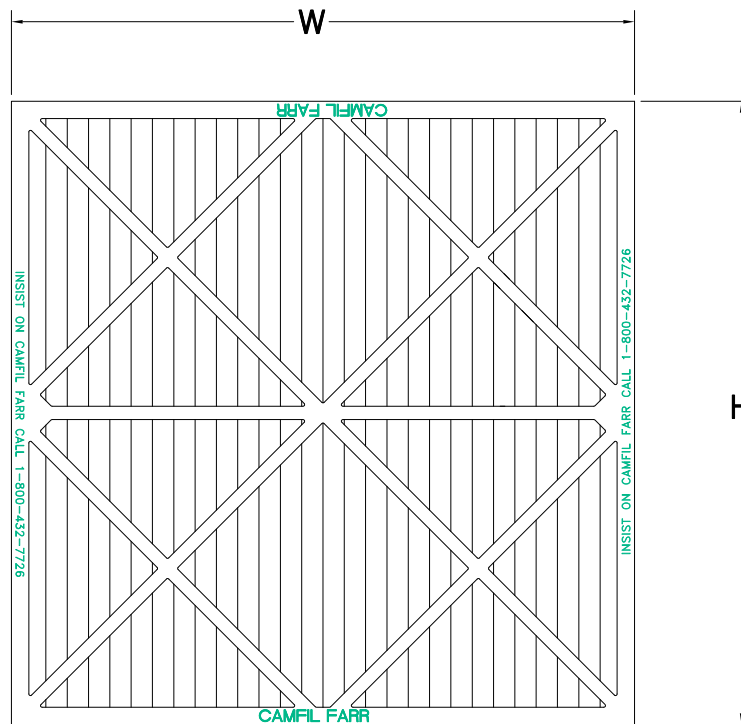

CUSTOMER APPROVAL BLOCK			
YOUR APPROVAL OF THIS PRINT AUTHORIZES CAMFIL FARR TO PROCEED WITH MATERIAL PROCUREMENT, TOOLING AND PRODUCT FABRICATION. ANY CHANGES MADE AFTER APPROVAL MAY INCUR FURTHER EXPENSES TO THE CUSTOMER			
<input type="checkbox"/> OK AS IS		<input type="checkbox"/> SEND REVISED DWG.	
SIGNATURE/DATE _____			
APPROVED BY:	DATE:	DRAWN BY:	DATE:
SM	5/27/09	JC	5/27/09



©Camfil Farr <http://www.camfilfarr.com>

DESCRIPTION  
OPTI-PAC ASHRAE GRADE FILTER  
MERV 11, MERV 13 & MERV 14

SHEET	DRAWING NUMBER	REV.
1 of 1	500641	E